


# PUMP SPECIFICATIONS

MODEL	MAX.CAPACITY (ml/min)		MAX.PRESSURE ( kgf/cm <sup>2</sup> )	R/V SET.PRESS. ( kgf/cm <sup>2</sup> )	STROKE PER MINUTE	
	50 Hz	60 Hz			50 Hz	60 Hz
KHV,H1-12	80	100	10	13	96	116

# PERFORMANCE CURVE

(EXPECTATION) CONDITIONS : WATER

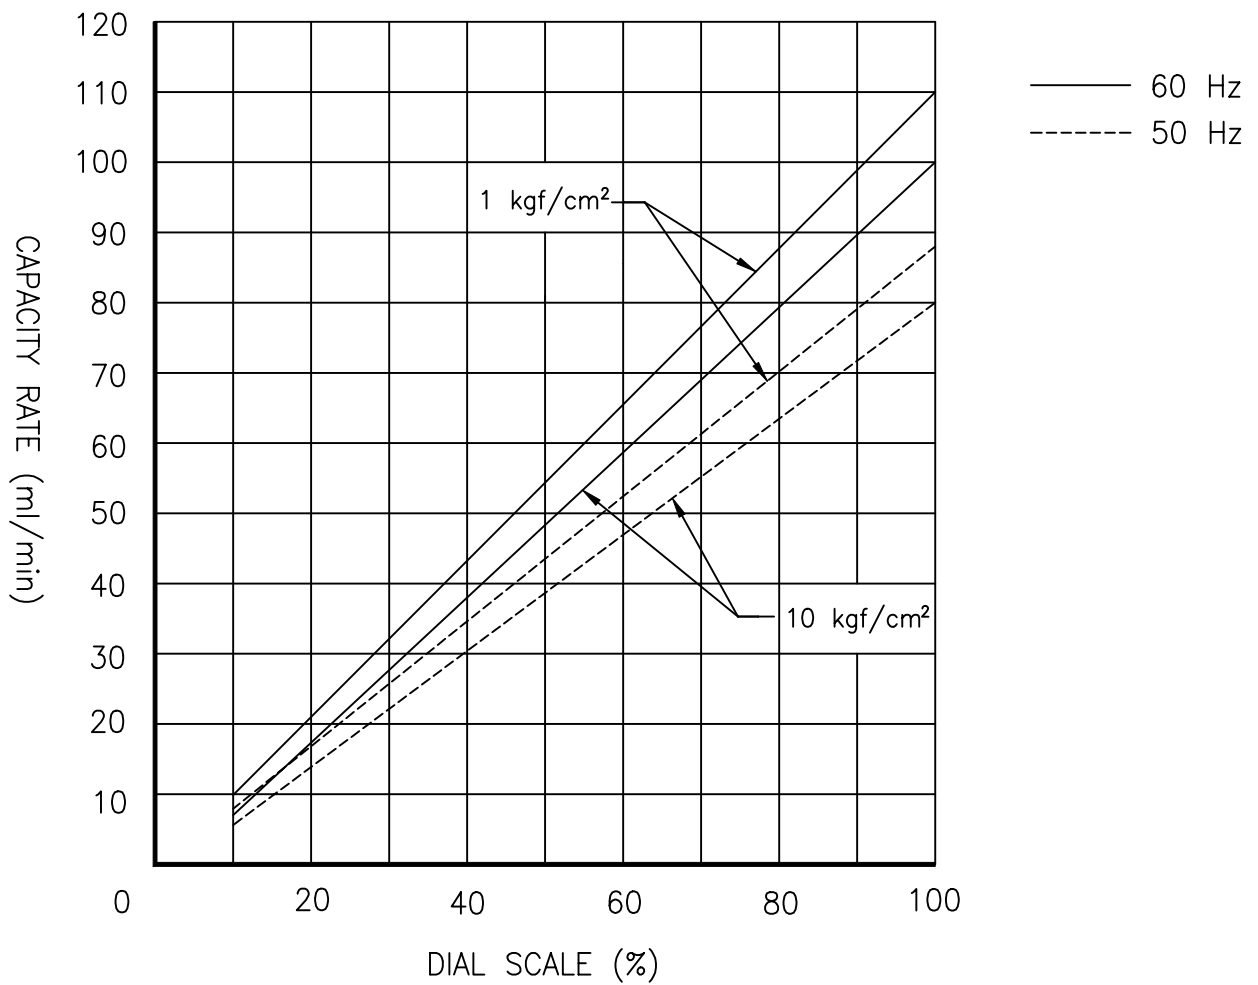

APPROVED		TITLE	PERFORMANCE CURVE
CHECKED		KHV,H1-12 PUMP(PVC,PVdF)	
DRAWN		DWG NO	760002
DATA	2000.09.25		

NO	REVISION DESCRIPTION	DATA	REVISED	APPROVED
△				
△				
△				
△				




**천세산업 주식회사**  
CHEON SEI IND. CO.,LTD.


# PUMP SPECIFICATIONS

MODEL	MAX.CAPACITY (ml/min)		MAX.PRESSURE ( kgf/cm <sup>2</sup> )	R/V SET.PRESS. ( kgf/cm <sup>2</sup> )	STROKE PER MINUTE	
	50 Hz	60 Hz			50 Hz	60 Hz
KHV,H1-12	80	100	30	36	96	116

# PERFORMANCE CURVE

(EXPECTATION) CONDITIONS : WATER

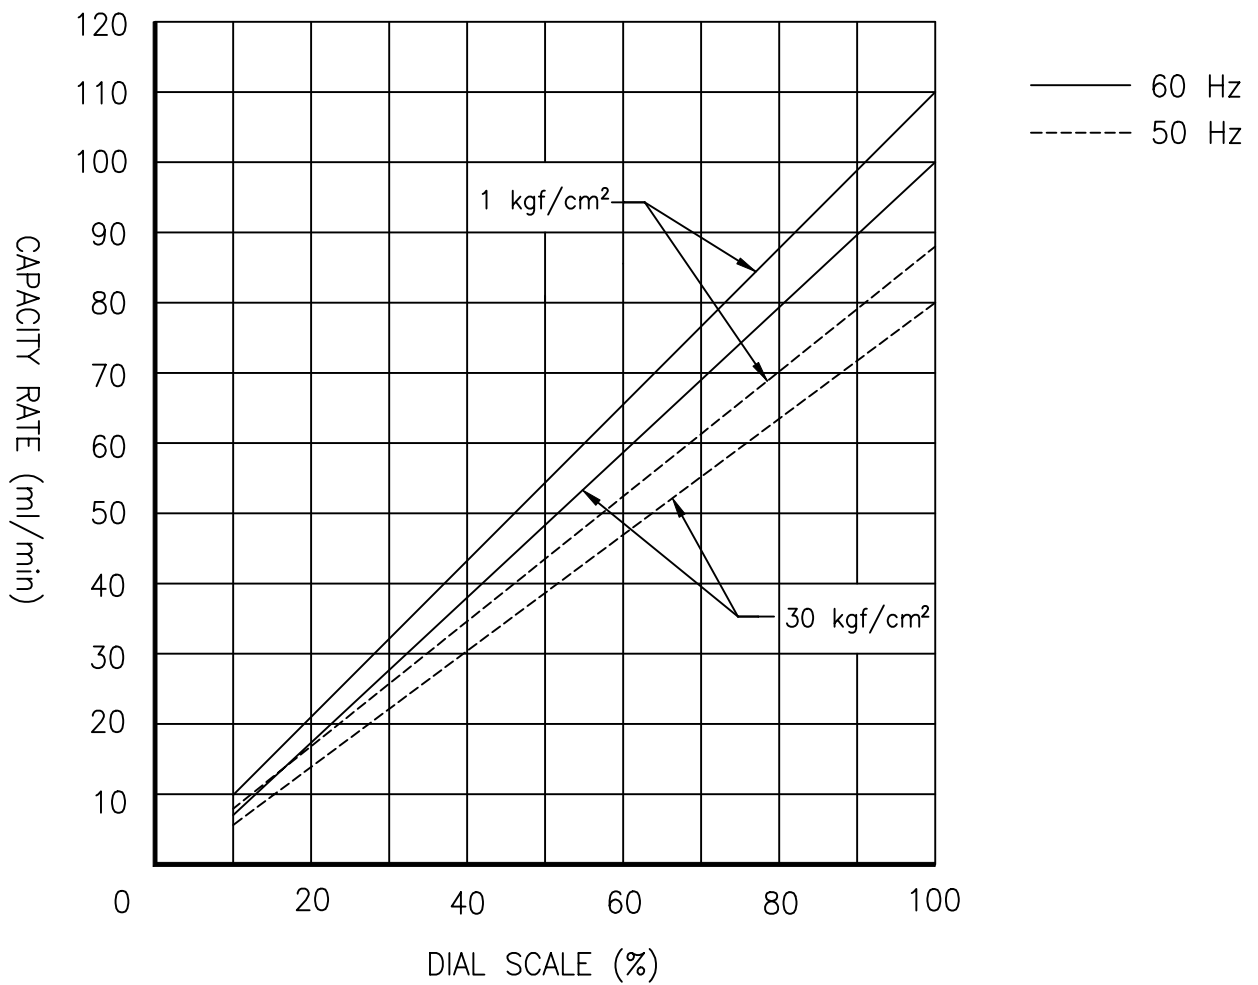

					APPROVED		TITLE	PERFORMANCE CURVE
					CHECKED		KHV,H1-12 PUMP(STS TYPE)	
					DRAWN		DWG NO	760012
					DATA	2000.09.25		
△					 <b>천세산업 주식회사</b> CHEON SEI IND. CO.,LTD.			
△								
△								
△								
NO	REVISION DESCRIPTION	DATA	REVISED	APPROVED				