



PUMP SPECIFICATIONS

| MODEL | MAX.CAPACITY (ml/min) | | MAX.PRESSURE (kgf/cm ²) | R/V SET.PRESS. (kgf/cm ²) | STROKE PER MINUTE | |
|-----------|-----------------------|-------|---|---|-------------------|-------|
| | 50 Hz | 60 Hz | | | 50 Hz | 60 Hz |
| KHV,H1-72 | 600 | 720 | 10 | 13 | 96 | 116 |

PERFORMANCE CURVE

(EXPECTATION) CONDITIONS : WATER

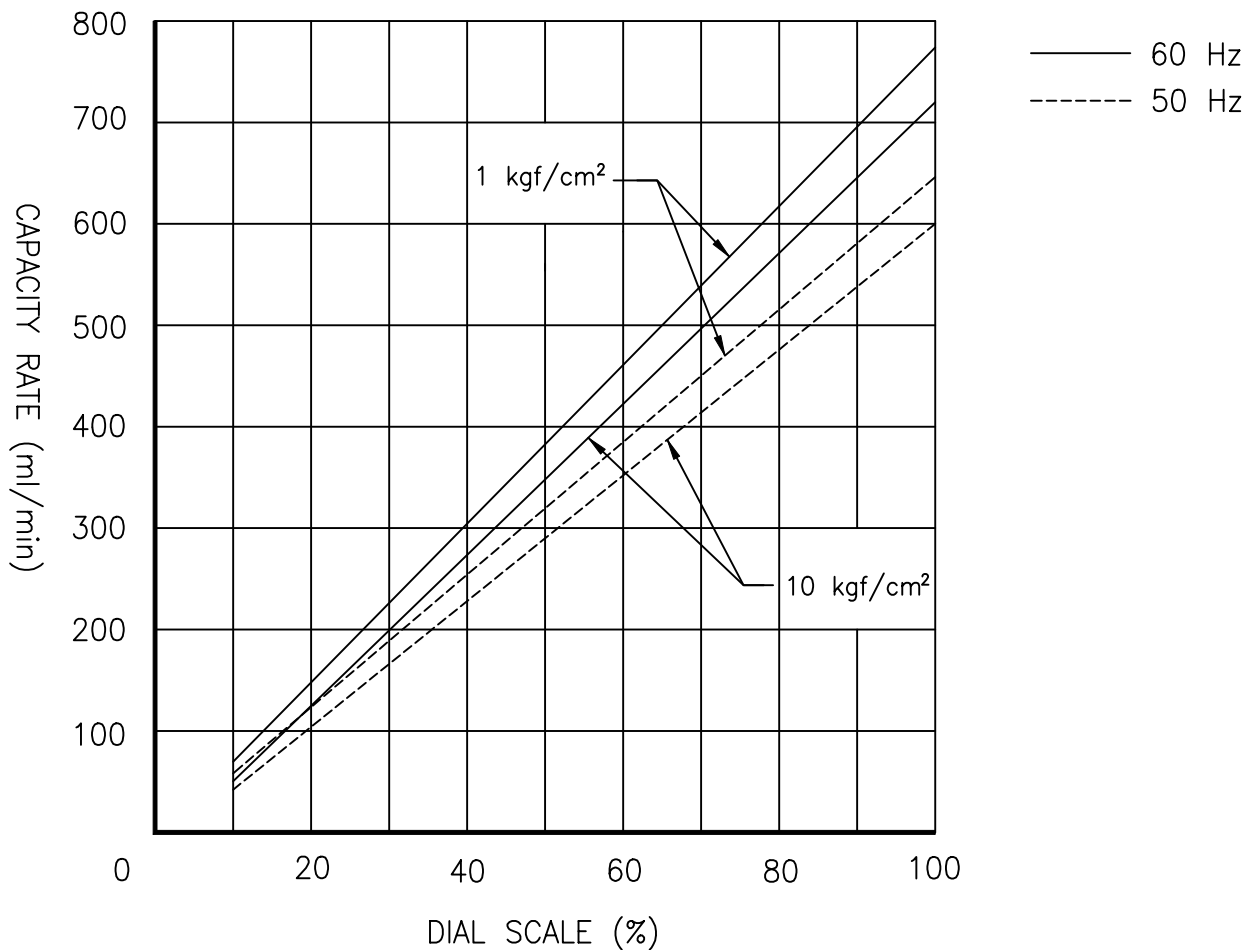


| | | | | | | | | |
|----|----------------------|------|---------|----------|---|------------|--------------------------|-------------------|
| | | | | | APPROVED | | TITLE | PERFORMANCE CURVE |
| | | | | | CHECKED | | KHV,H1-72 PUMP(PVC,PVdF) | |
| | | | | | DRAWN | | DWG NO | 760004 |
| | | | | | DATA | 2000.09.25 | | |
| △ | | | | |  천세산업 주식회사 CHEON SEI IND. CO.,LTD. | | | |
| △ | | | | | | | | |
| △ | | | | | | | | |
| △ | | | | | | | | |
| NO | REVISION DESCRIPTION | DATA | REVISED | APPROVED | | | | |


PUMP SPECIFICATIONS

| MODEL | MAX.CAPACITY (ml/min) | | MAX.PRESSURE (kgf/cm ²) | R/V SET.PRESS. (kgf/cm ²) | STROKE PER MINUTE | |
|-----------|-----------------------|-------|---|---|-------------------|-------|
| | 50 Hz | 60 Hz | | | 50 Hz | 60 Hz |
| KHV,H1-72 | 600 | 720 | 20 | 26 | 96 | 116 |

PERFORMANCE CURVE

(EXPECTATION) CONDITIONS : WATER

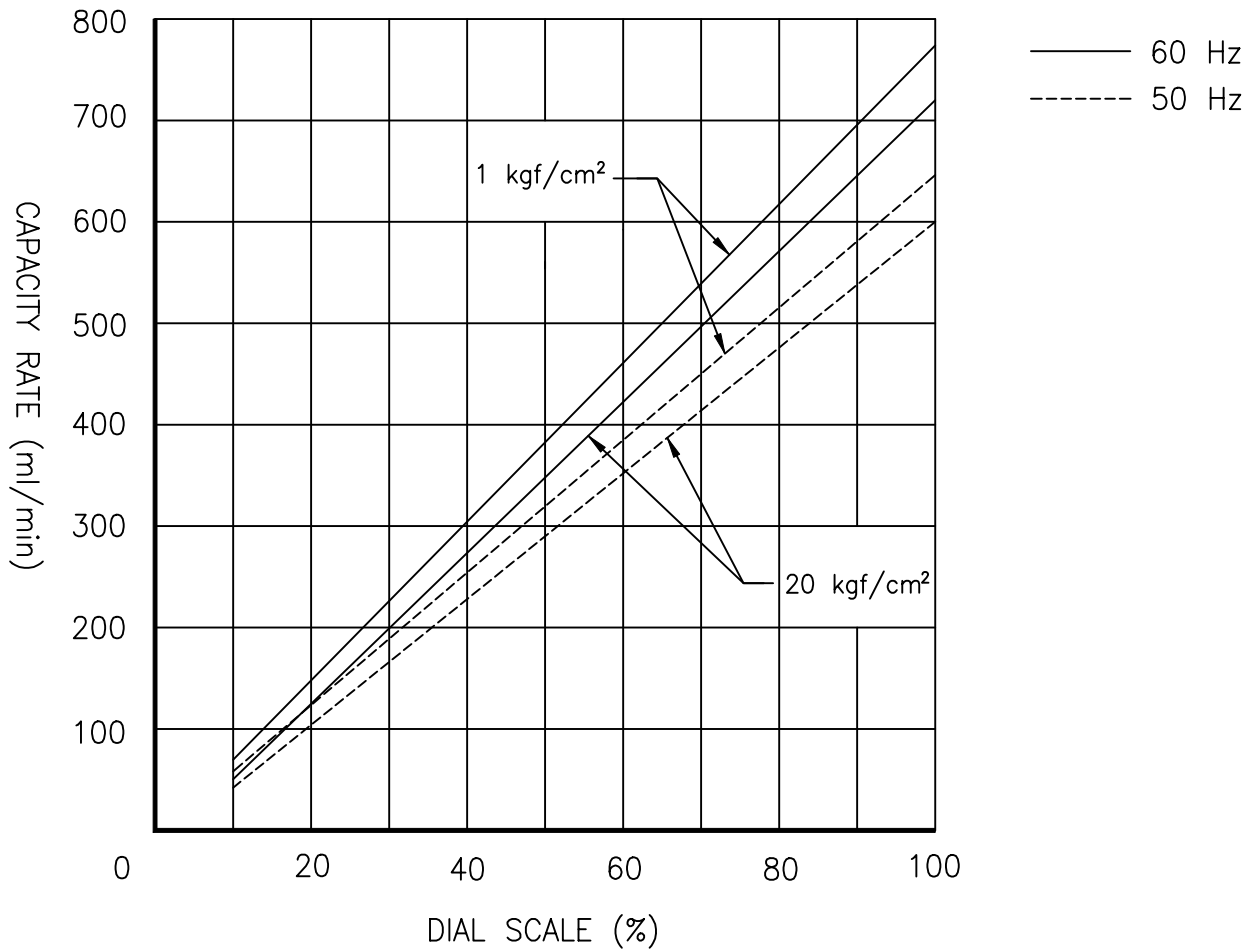

| | | | | | | | | |
|----|----------------------|------|---------|----------|---|------------|--------|--------------------------|
| | | | | | APPROVED | | TITLE | PERFORMANCE CURVE |
| | | | | | CHECKED | | | KHV,H1-72 PUMP(STS TYPE) |
| △ | | | | | DRAWN | | DWG NO | 760014 |
| △ | | | | | DATA | 2000.09.25 | | |
| △ | | | | |  천세산업 주식회사 CHEON SEI IND. CO.,LTD. | | | |
| △ | | | | | | | | |
| NO | REVISION DESCRIPTION | DATA | REVISED | APPROVED | | | | |